


10:00 PM

TO EXISTING DC FOR MORE clean AIR EFF.

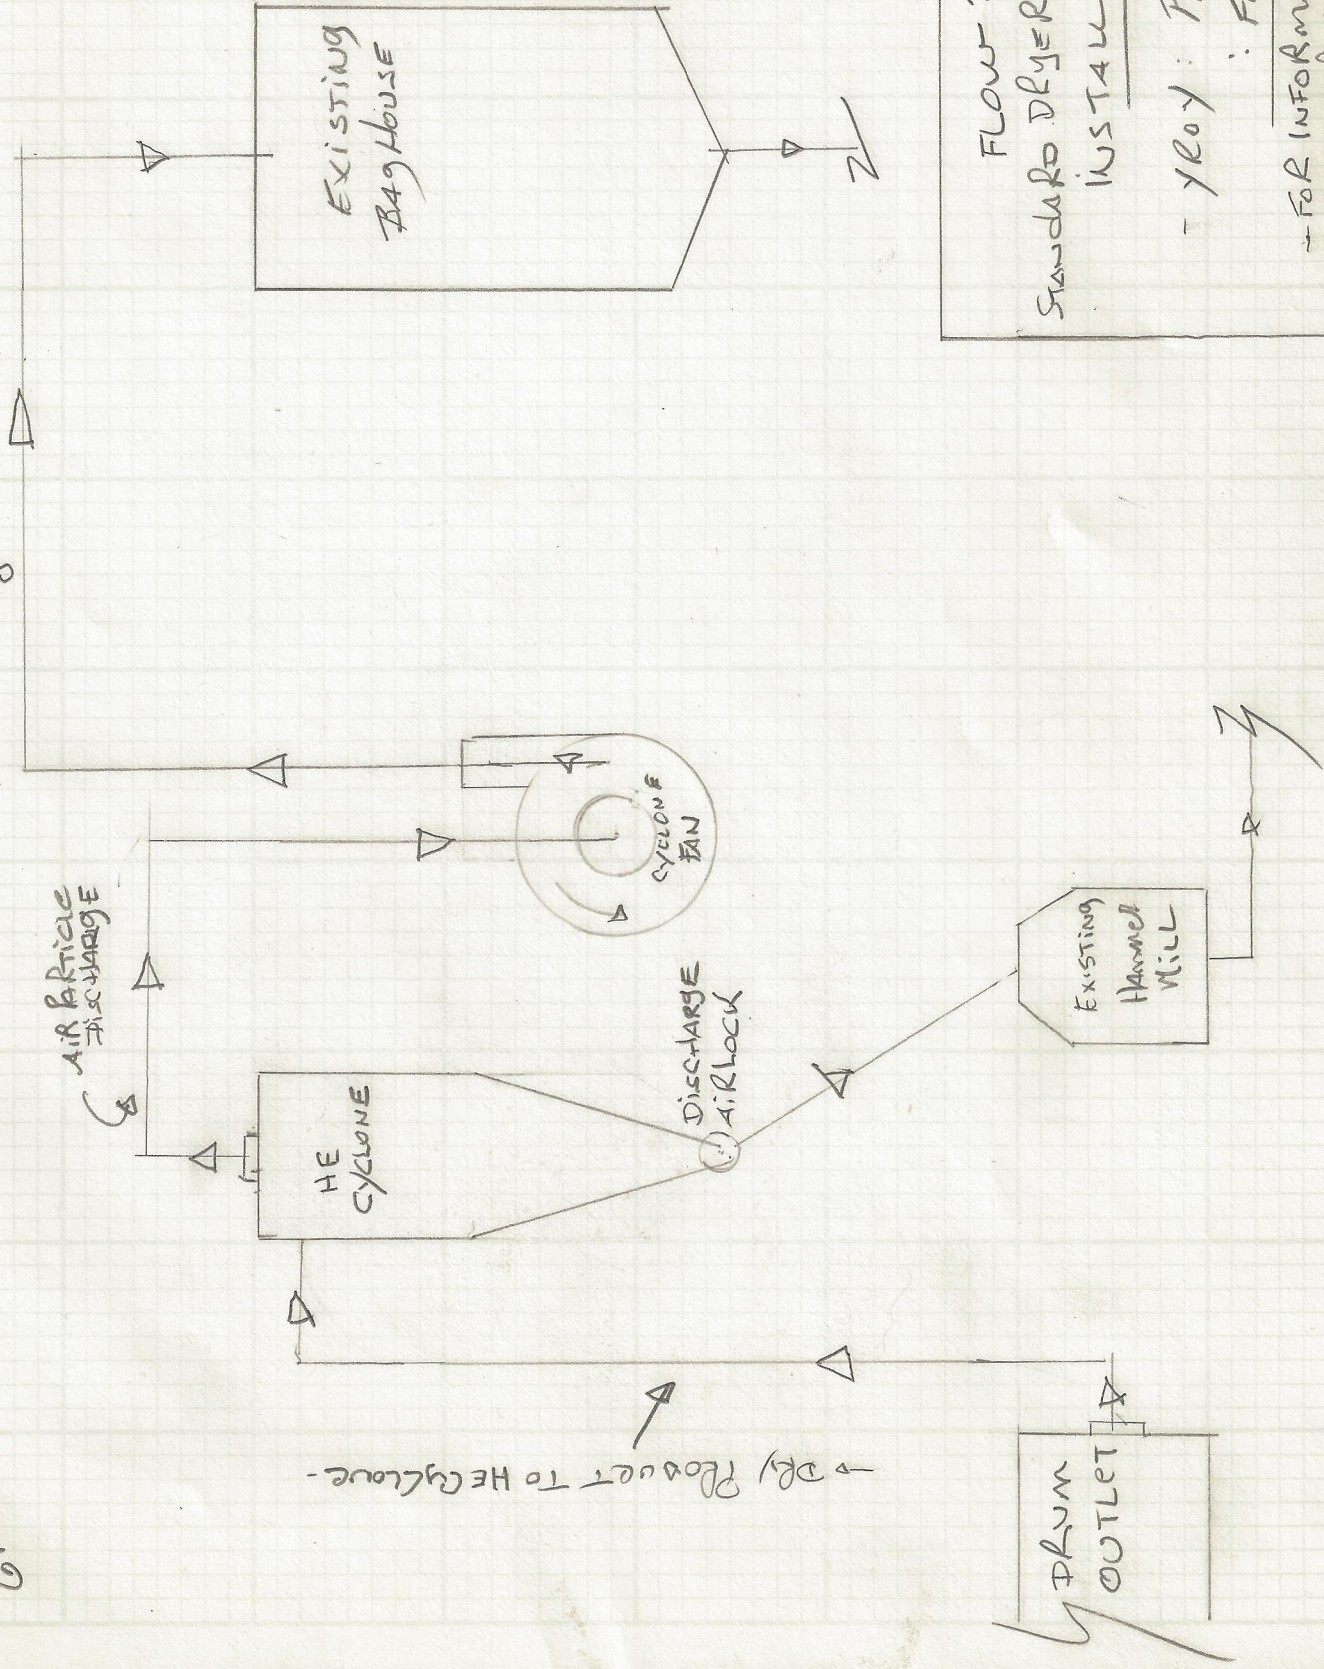

→ Dry Product to HE cyclone.

Flow Diagram
Standard Dryer Air System
Installation.
- Yroy: Processo Inc
: FEB-10-2012
- FOR INFORMATION ONLY.
NOT FOR CONSTRUCTION